



Project: GREENACRES ELEMENTARY SCHOOL	Date: 01.16.2020
Address: 41 HUNTINGTON AVENUE, SCARSDALE NY	Job ID / MU #:
Client: PARK EAST CONSTRUCTION	Weather: SUNNY

Inspection Type: NOISE AND DUST MONITOR	Contractor:
Present At Site: 7:00AM	Sub-Contractor:
General Area:	CM/Designer:
Specific Location: NORTHERN BASEMENT, 1ST FLOOR, 2ND FLOOR	
Last Inspection:	Building Code Section:
Reviewed	Drawings:
Approved	Submittals
	Other:

Deficiency:	Resolution:

Request For Information:					
Non-Conformance Report:					
RFI # : <input type="checkbox"/> Issued	RFI # : <input type="checkbox"/> Answered	NCR # : <input type="checkbox"/> Issued	NCR # : <input type="checkbox"/> Resolved	NCR # : <input type="checkbox"/> Open	

Observations/Notes:

Noise caused by ongoing construction in the perimeter of the school was monitored using a sound level meter. Readings were taken in the basement hallway (20 feet from construction) next to the work performed today.

An average noise level of 50.12 db was measured for the day.

Dust levels within the perimeter of the school were measured. These readings can be found in the chart on the next page. Daily PM2.5 Density = 3.8, PM10 Density = 7.7

Work today included: cutting red brick, cutting metal studs, excavation of 3" river rock and 3/4" river rock, lull running, cement mixer running.

Attachments/Photos:

Time on site: 7:00am	Time off site: 3:30pm
----------------------	-----------------------

Inspected Work Satisfactory (Except As Noted): <input checked="" type="checkbox"/> No: <input type="checkbox"/>	Re-inspection Required: <input type="checkbox"/>	Work Completed: <input type="checkbox"/>
---	--	--

Inspector: Erald Hysaj	Signature:	Certification: _____
------------------------	------------	----------------------



MUNICIPAL
TESTING LABORATORY, INC.

375 RABRO DRIVE, HAUPPAUGE NY 11788
• TEL: (631) 761-5555 • www.mtllab.net
NYC DoB Special Inspection Agency #0230

INSPECTION REPORT

REPORT #

PHOTOS TAKEN

Page of

Date	Time	Location	Sample	2.5 microns	10 microns	Temp	RH%
01.15	07:31	basement	1	2	5	76.2	35.1
	07:37	1st floor	2	3	6	71.2	31.2
	07:45	2nd floor	3	5	7	71.0	31.0
	08:43	basement	4	4	8	76.0	35.5
	08:48	1st floor	5	7	15	70.4	30.8
	08:55	2nd floor	6	6	11	70.9	30.9
	09:02	basement	7	8	17	75.5	35.0
	09:08	1st floor	8	3	6	70.0	31.2
	09:14	2nd floor	9	2	5	70.5	35.2
	10:43	basement	10	3	7	76.0	30.7
	10:49	1st floor	11	5	9	69.4	30.3
	10:55	2nd floor	12	2	4	69.5	30.2
	11:02	basement	13	4	9	75.4	35.5
	11:08	1st floor	14	6	12	70.0	31.8
	11:15	2nd floor	15	7	14	69.0	30.7
	12:43	basement	16	2	4	72.7	35.2
	12:49	1st floor	17	4	10	68.0	31.2
	12:55	2nd floor	18	5	9	67.7	31.5

NOTICE

The field representative is on site solely to observe operation of the contractor identified, for the work identified and it's conformance to the contract documents, and report those operations to the client. The presence and activities of the field representative do not relieve the contractor's obligation to meet the contractual requirements. The contractor retains sole responsibility for site safety and means/methods of construction success. The field representative is not responsible for identifying errors and omissions in the contract documents.




INSPECTION REPORT

PHOTOS TAKEN

[illegible]

The field representative is on site solely to observe operation of the contractor identified, for the work identified and it's conformance to the contract documents, and report those operations to the client. The presence and activities of the field representative do not relieve the contractor's obligation to meet the contractual requirements. The contractor retains sole responsibility for site safety and means/methods of construction. The field representative is not responsible for identifying errors and omissions in the contract documents.


Standard Sound Level Meter RealTime Graph
Time: 2020-1-16 14:49:19

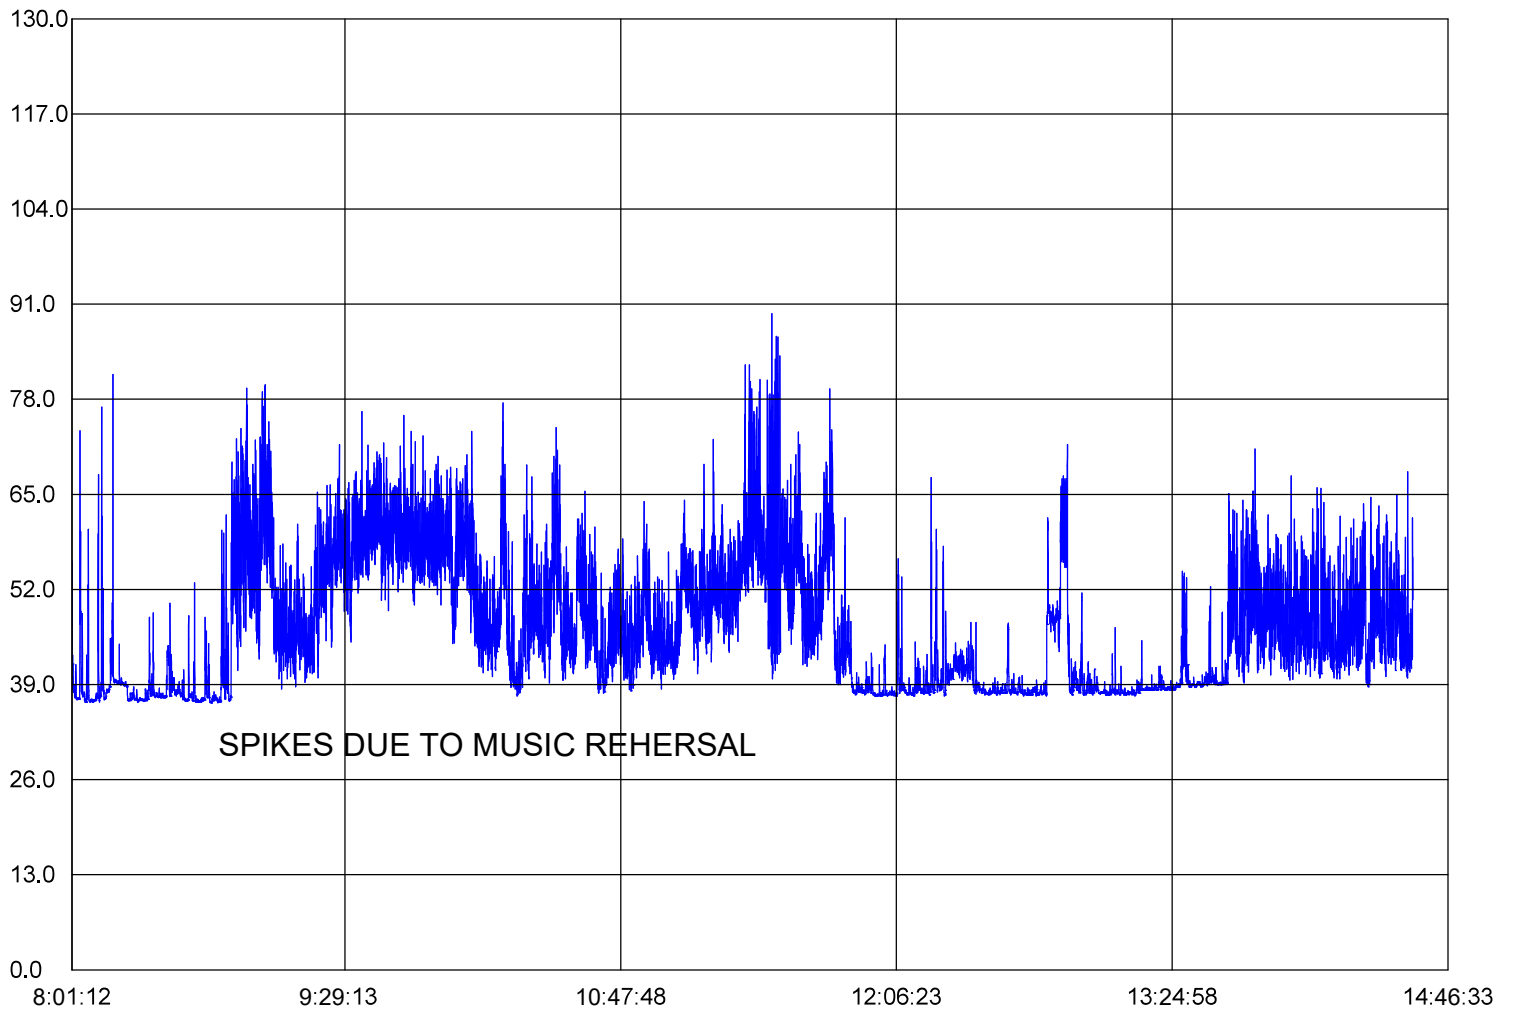

Start Time: 16-01-2020,8:01:12
Maxnum: 83.50 16-01-2020,11:39:56
Minnum: 32.40 16-01-2020,9:40:43
Sample Rate: 1.00
Average: 47.51

BASEMENT HALLWAY

Standard Sound Level Meter RealTime Graph
Time: 2019-1-16 14:52:29

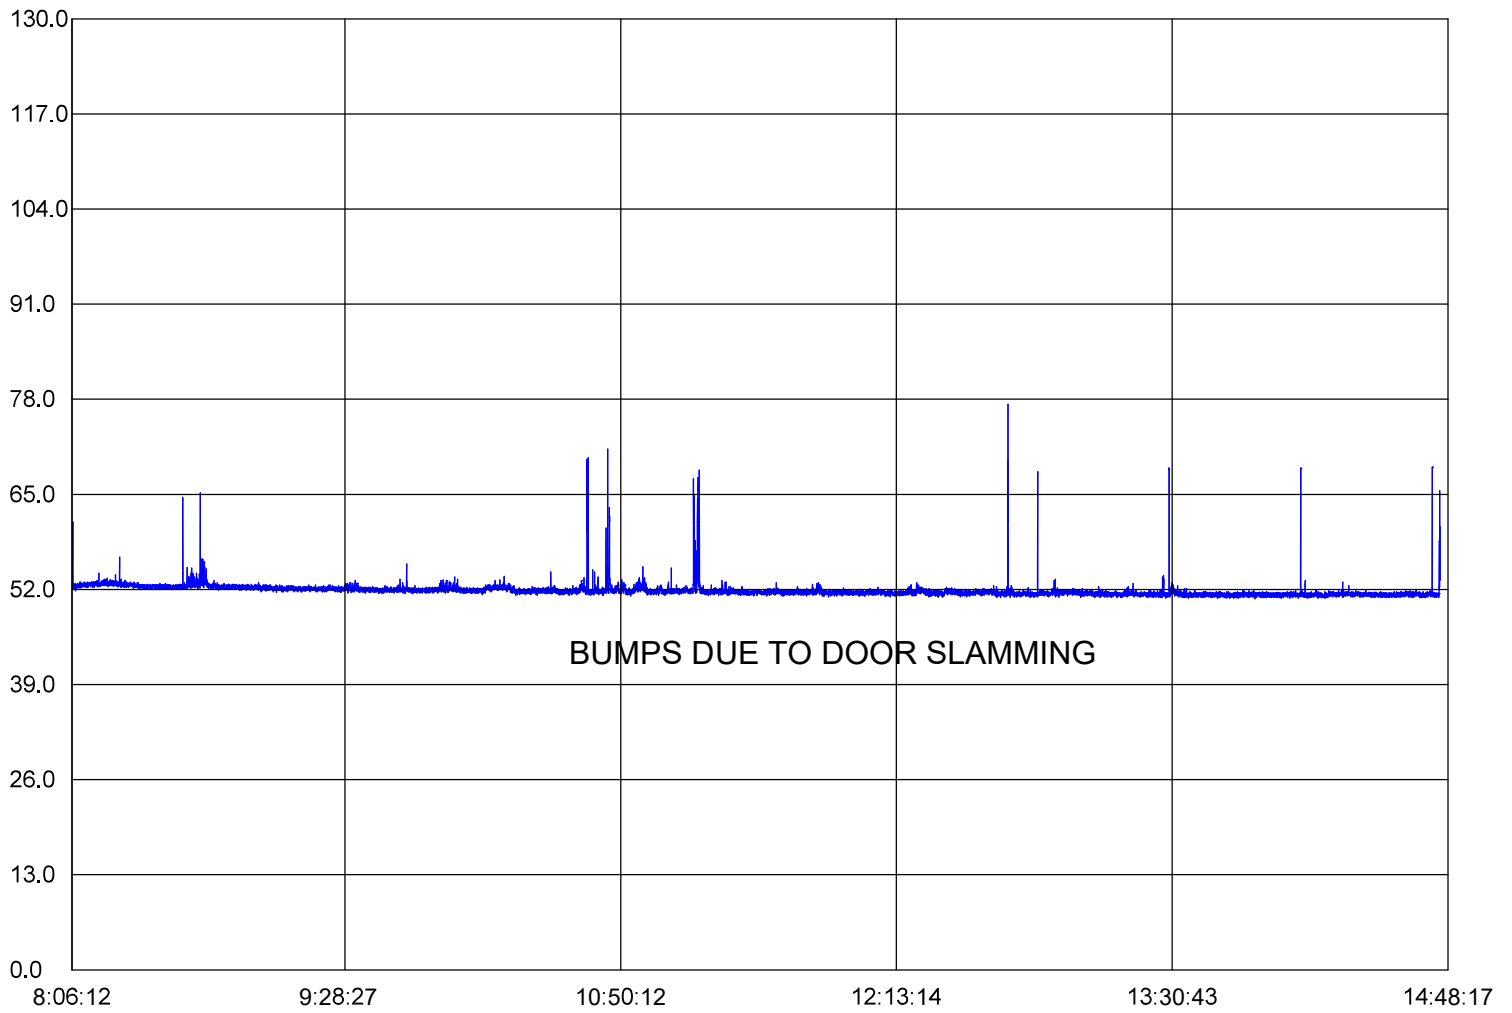

2nd floor storage

Start Time: 16-01-2019,8:06:12
Maxnum: 76.40 16-01-2019,12:18:21
Minnum: 51.40 16-01-2019,13:24:40
Sample Rate: 1.00
Average: 52.73