



**MUNICIPAL**  
TESTING LABORATORY, INC.

## INSPECTION REPORT

REPORT #

49

SAMPLES TAKEN

Page of

Project: <b>Greenacres School</b>	<b>DATE: 11/08/19</b>
Address: <b>41 Huntington Avenue, Scarsdale NY 10583</b>	<b>JOB ID:</b>
Client: <b>Park East Construction</b>	<b>WEATHER: SUNNY</b>

Inspection Type: <b>Noise and Dust Monitoring</b>	Contractor: <b>Park East</b>
Present At Site: <b>7:00AM</b>	Sub-Contractor:
General Area: <b>Northern Yard of School</b>	CM/Designer:
Specific Location: <b>Northern Side of school 1st, 2nd floor, Basement</b>	
Last Inspection:	Building Code Section:
Reviewed	Drawings:
Approved	Submittals
	Other:

Deficiency:	Resolution:			
Request For Information:				
Non-Conformance Report:				
RFI # : <input type="checkbox"/> Issued	RFI # : <input type="checkbox"/> Answered	NCR # : <input type="checkbox"/> Issued	NCR # : <input type="checkbox"/> Resolved	NCR # : <input type="checkbox"/> Open
Observations/Notes:				

Noise caused by ongoing construction in the perimeter of the school was monitored using a sound meter. Readings were taken in the basement hallway (20 feet from construction), next to the work performed today.

An Average noise level of 47.12 dB was measured for the day

Dust Levels within the Perimeter of the school were measured. These Readings can be found in the chart on the next page. Daily PM2.5 density = 1.2, PM10 density = 3.3

Work today included: broke concrete and removed it, Erection of I-Beams

Attachments/Photos:

Time on site: <b>7:00 AM</b>	Time off site: <b>3:30 PM</b>
Inspected Work Satisfactory (Except As Noted): <input checked="" type="checkbox"/> No: <input type="checkbox"/>	Re-inspection Required: <input type="checkbox"/> Work Completed: <input type="checkbox"/>

Inspector: **Erald Hysaj** Signature: \_\_\_\_\_ Certification: \_\_\_\_\_

**NOTICE:** The field representative is on site solely to observe operation of the contractor identified, for the work identified and it's conformance to the contract documents, and report those operations to the client. The presence and activities of the field representative do not relieve the contractor's obligation to meet contractual requirements. The contractor retains sole responsibility for site safety and means/methods of construction sequences. The field representative is not responsible for identifying errors and omissions in the contract documents. Rev.11/14/17



375 RABRO DRIVE, HAUPPAUGE NY 11788  
 • TEL: (631) 761-5555 • www.mtllab.net  
 NYC DoB Special Inspection Agency #0230

## INSPECTION REPORT

REPORT #

PHOTOS TAKEN


Page of

Date	Time	Location	Sample	2.5 microns	10 microns	Temp	RH%
November 08, 2019	08:18	BASEMENT	1	0	1	67.2	43.5
	08:25	1ST FLOOR	2	0	2	68.3	44.2
	08:31	2ND FLOOR	3	1	4	68.7	45.3
	09:32	BASEMENT	4	2	5	68.1	44.2
	09:39	1ST FLOOR	5	1	1	69.2	48.9
	09:45	2ND FLOOR	6	0	0	69.4	49.4
	10:43	BASEMENT	7	1	3	67.9	48.7
	10:49	1ST FLOOR	8	4	9	70.4	49.5
	10:55	2ND FLOOR	9	1	2	70.8	51.3
	11:00	2ND FLOOR STORAGE	10	0	3	68.1	48.7
	11:06	BASEMENT	11	0	2	68.3	51.8
	11:12	1ST FLOOR	12	3	6	70.9	52.0
	12:43	BASEMENT	13	2	5	68.3	48.7
	12:49	1ST FLOOR	14	0	1	71.5	47.9
	12:55	2ND FLOOR	15	2	4	71.7	47.3
	13:00	2ND FLOOR STORAGE	16	1	2	68.8	45.7
	13:06	BASEMENT	17	0	0	68.4	46.7
	13:12	1ST FLOOR	18	0	2	71.6	45.4
	14:00	2ND FLOOR	19	4	5	72.3	45.8
	14:06	2ND FLOOR STORAGE	20	5	10	68.9	46.3
	14:15	BASEMENT	21	1	2	69.3	45.4

### NOTICE

The field representative is on site solely to observe operation of the contractor identified, for the work identified and it's conformance to the contract documents, and report those operations to the client. The presence and activities of the field representative do not relieve the contractor's obligation to meet the contractual requirements. The contractor retains sole responsibility for site safety and means/methods of construction success. The field representative is not responsible for identifying errors and omissions in the contract documents.


Standard Sound Level Meter RealTime Graph  
Time: 2019-11-8 14:59:22

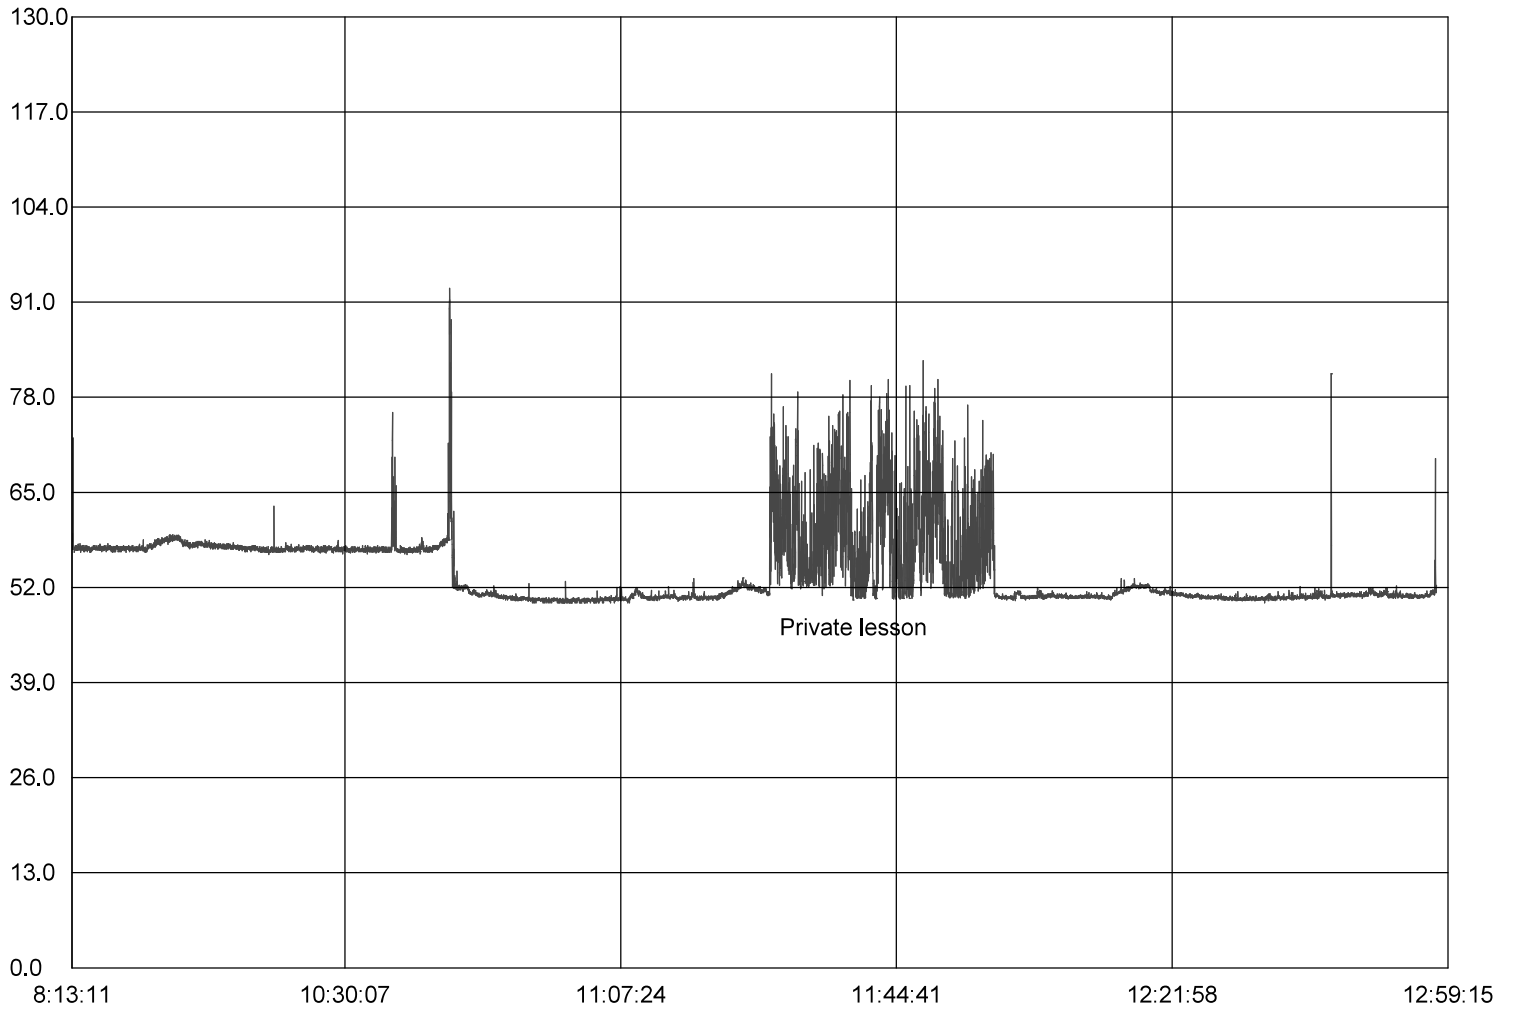

Start Time: 08-11-2019,8:13:11  
Maxnum: 92.90 08-11-2019,10:44:17  
Minnum: 49.90 08-11-2019,10:55:29  
Sample Rate: 1.00  
Average: 54.13

2ND FLOOR STORAGE CLOSET


Standard Sound Level Meter RealTime Graph  
Time: 2019-11-8 14:59:33

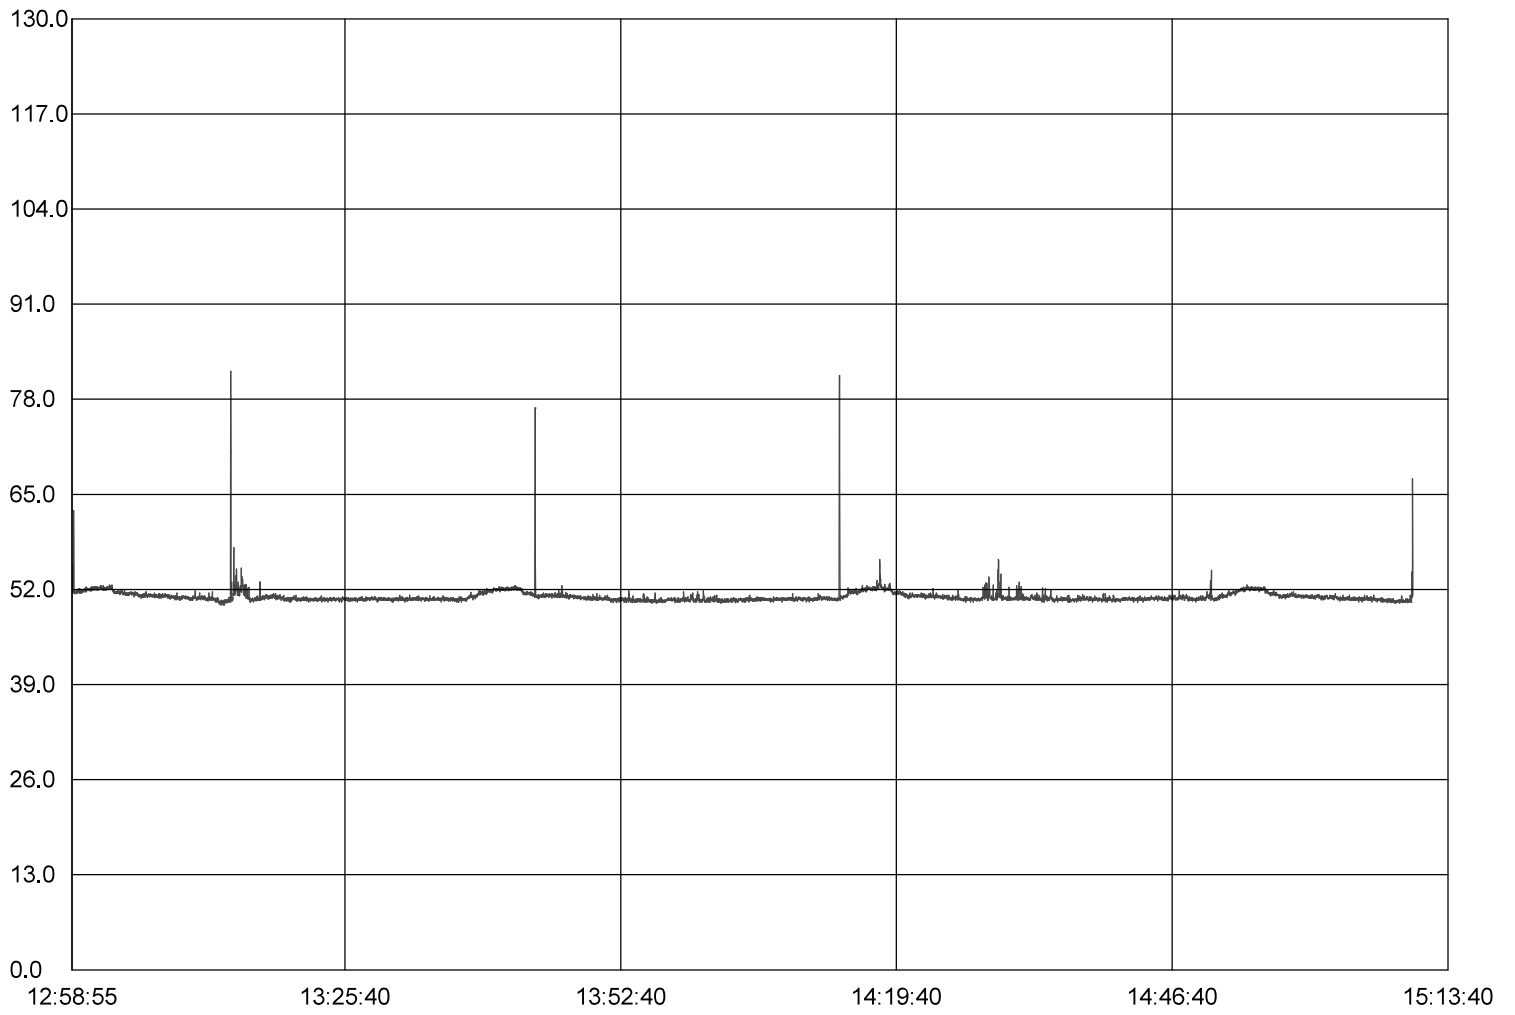

Start Time: 08-11-2019,12:58:55  
Maxnum: 81.80 08-11-2019,13:14:29  
Minnum: 49.90 08-11-2019,13:13:26  
Sample Rate: 1.00  
Average: 51.00

2nd Floor Storage 2


Standard Sound Level Meter RealTime Graph  
Time: 2019-11-8 14:56:23

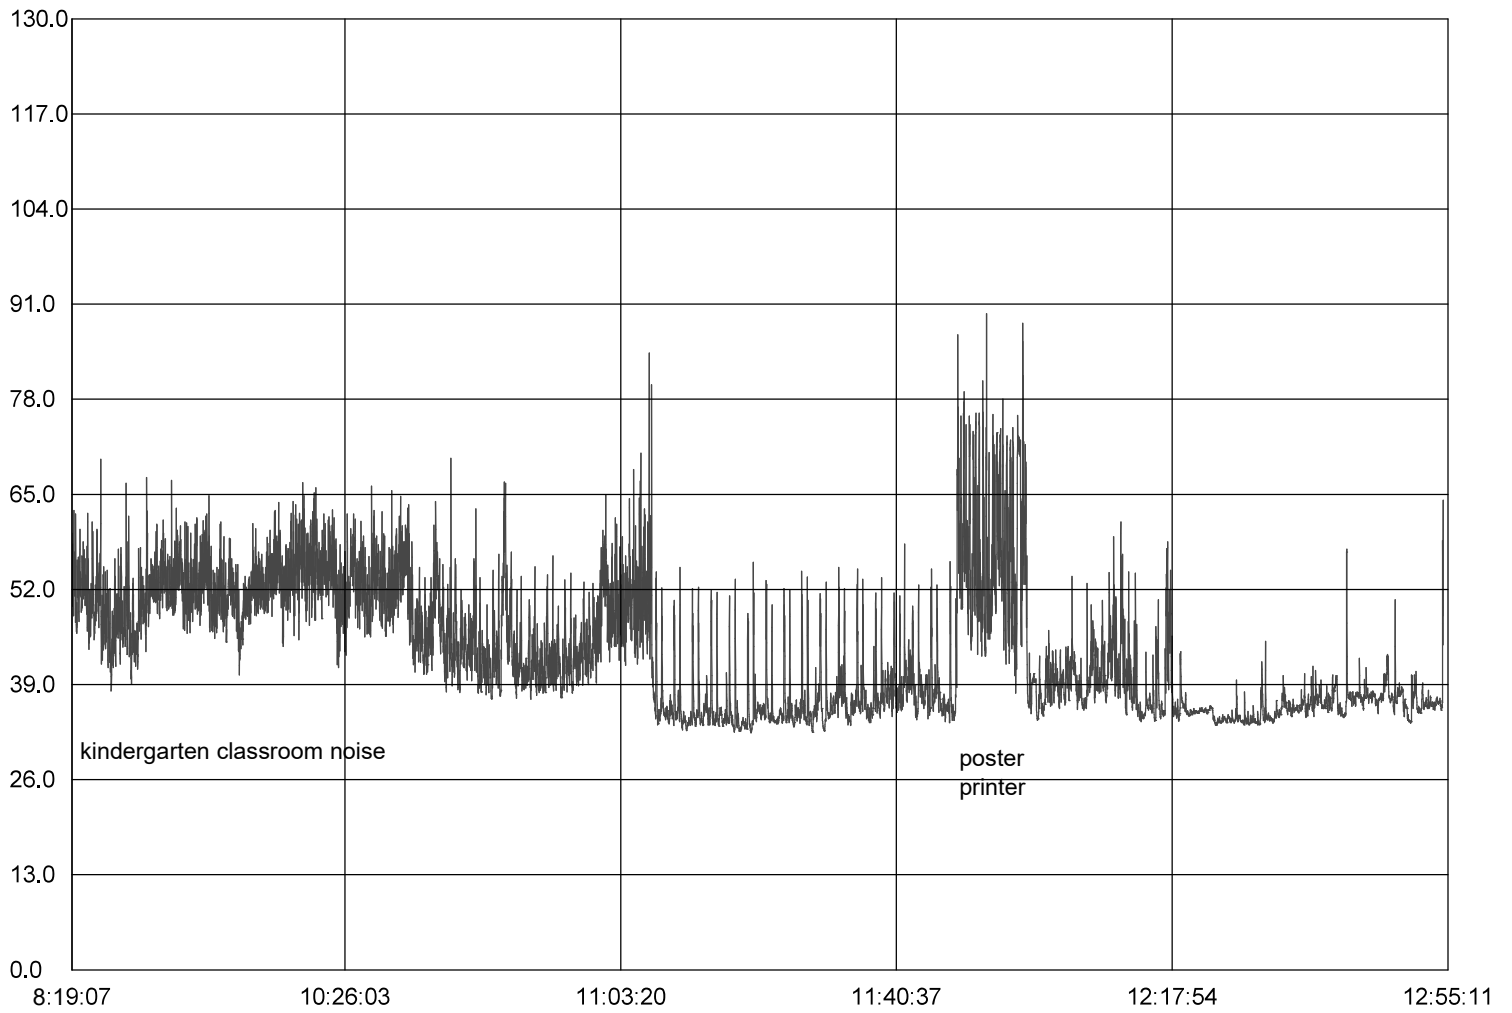

Start Time: 08-11-2019,8:19:07  
Maxnum: 89.70 08-11-2019,11:52:49  
Minnum: 32.40 08-11-2019,11:20:58  
Sample Rate: 1.00  
Average: 43.37

basement hallway 1

Standard Sound Level Meter RealTime Graph  
Time: 2019-11-8 14:56:34

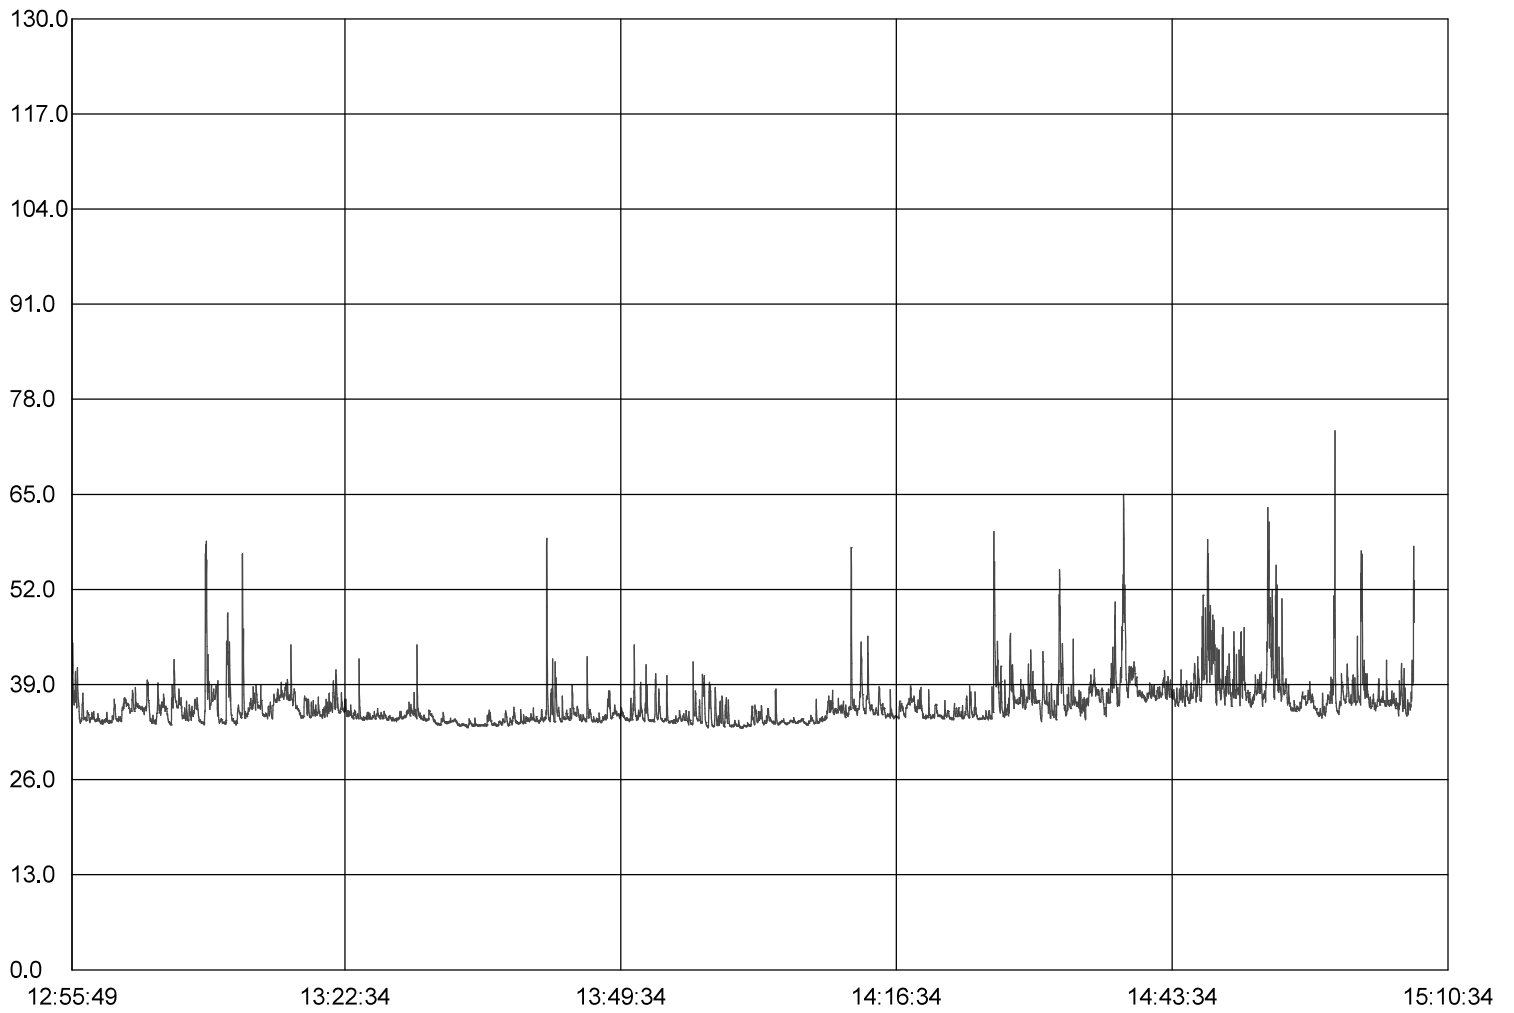

Start Time: 08-11-2019,12:55:49  
Maxnum: 73.70 08-11-2019,14:59:31  
Minnum: 33.00 08-11-2019,14:01:26  
Sample Rate: 1.00  
Average: 36.13

basement hallway 2